





FLP-5441KPM

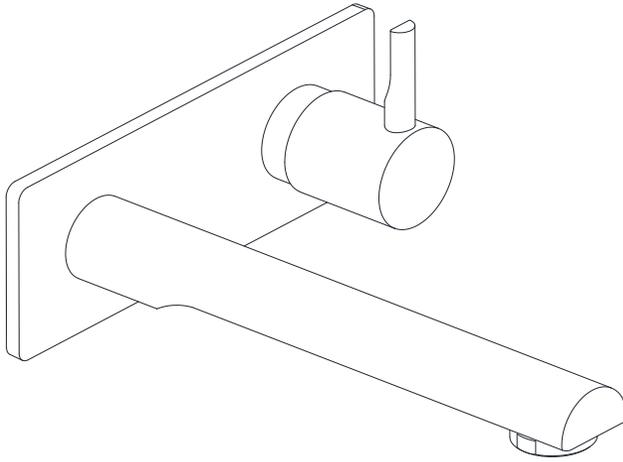



TEMP.& WATER PRESSURE REQUIREMENTS

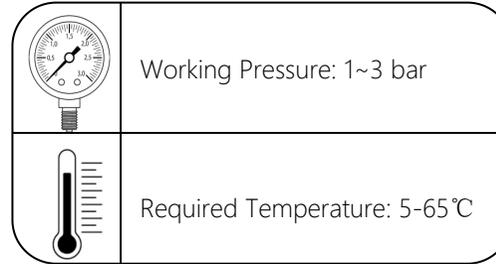






Note: Above are the recommended values for getting Conventional Output.

TECHNICAL DRAWING

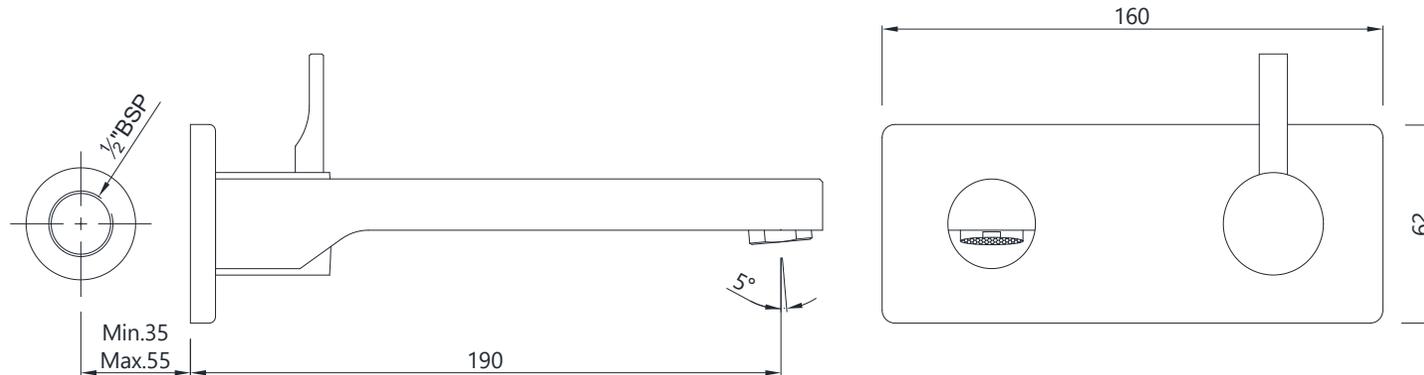

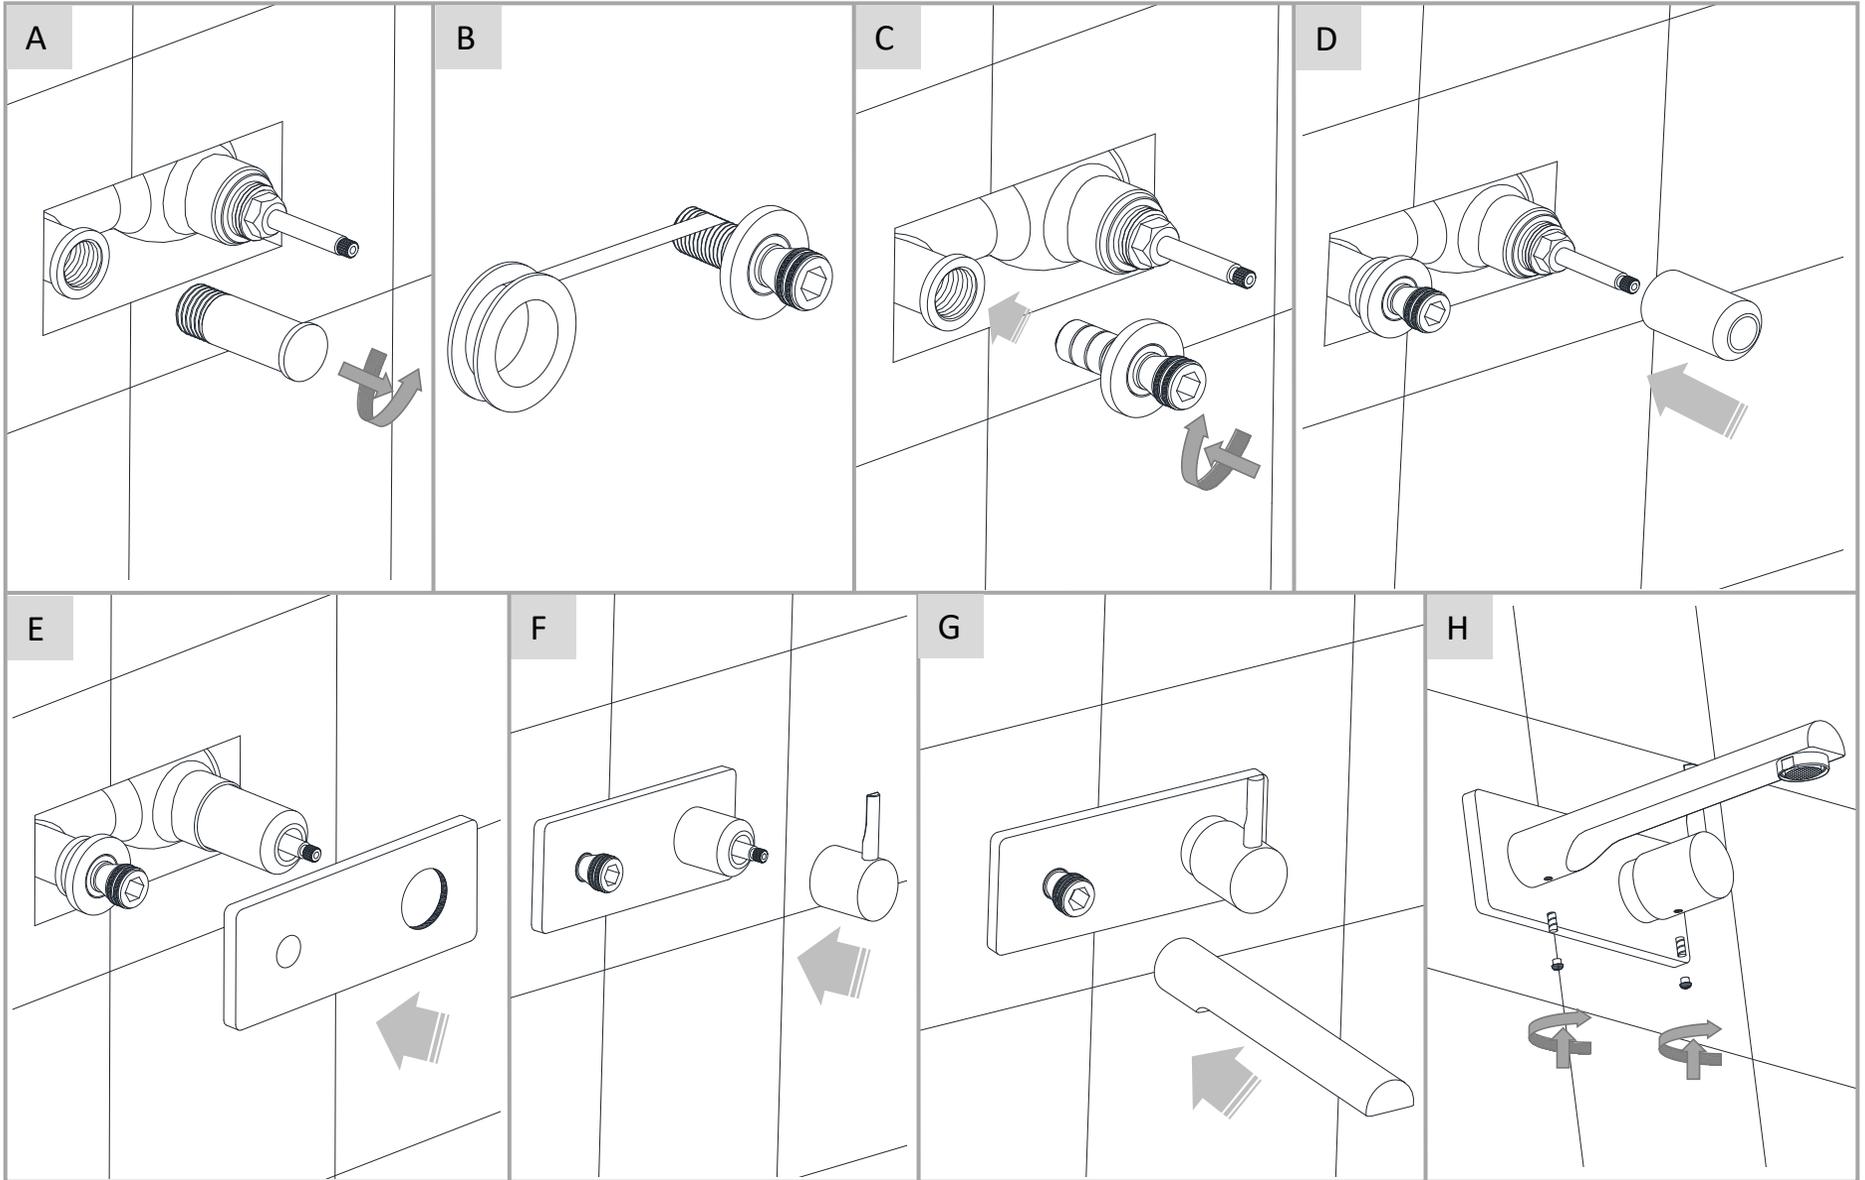

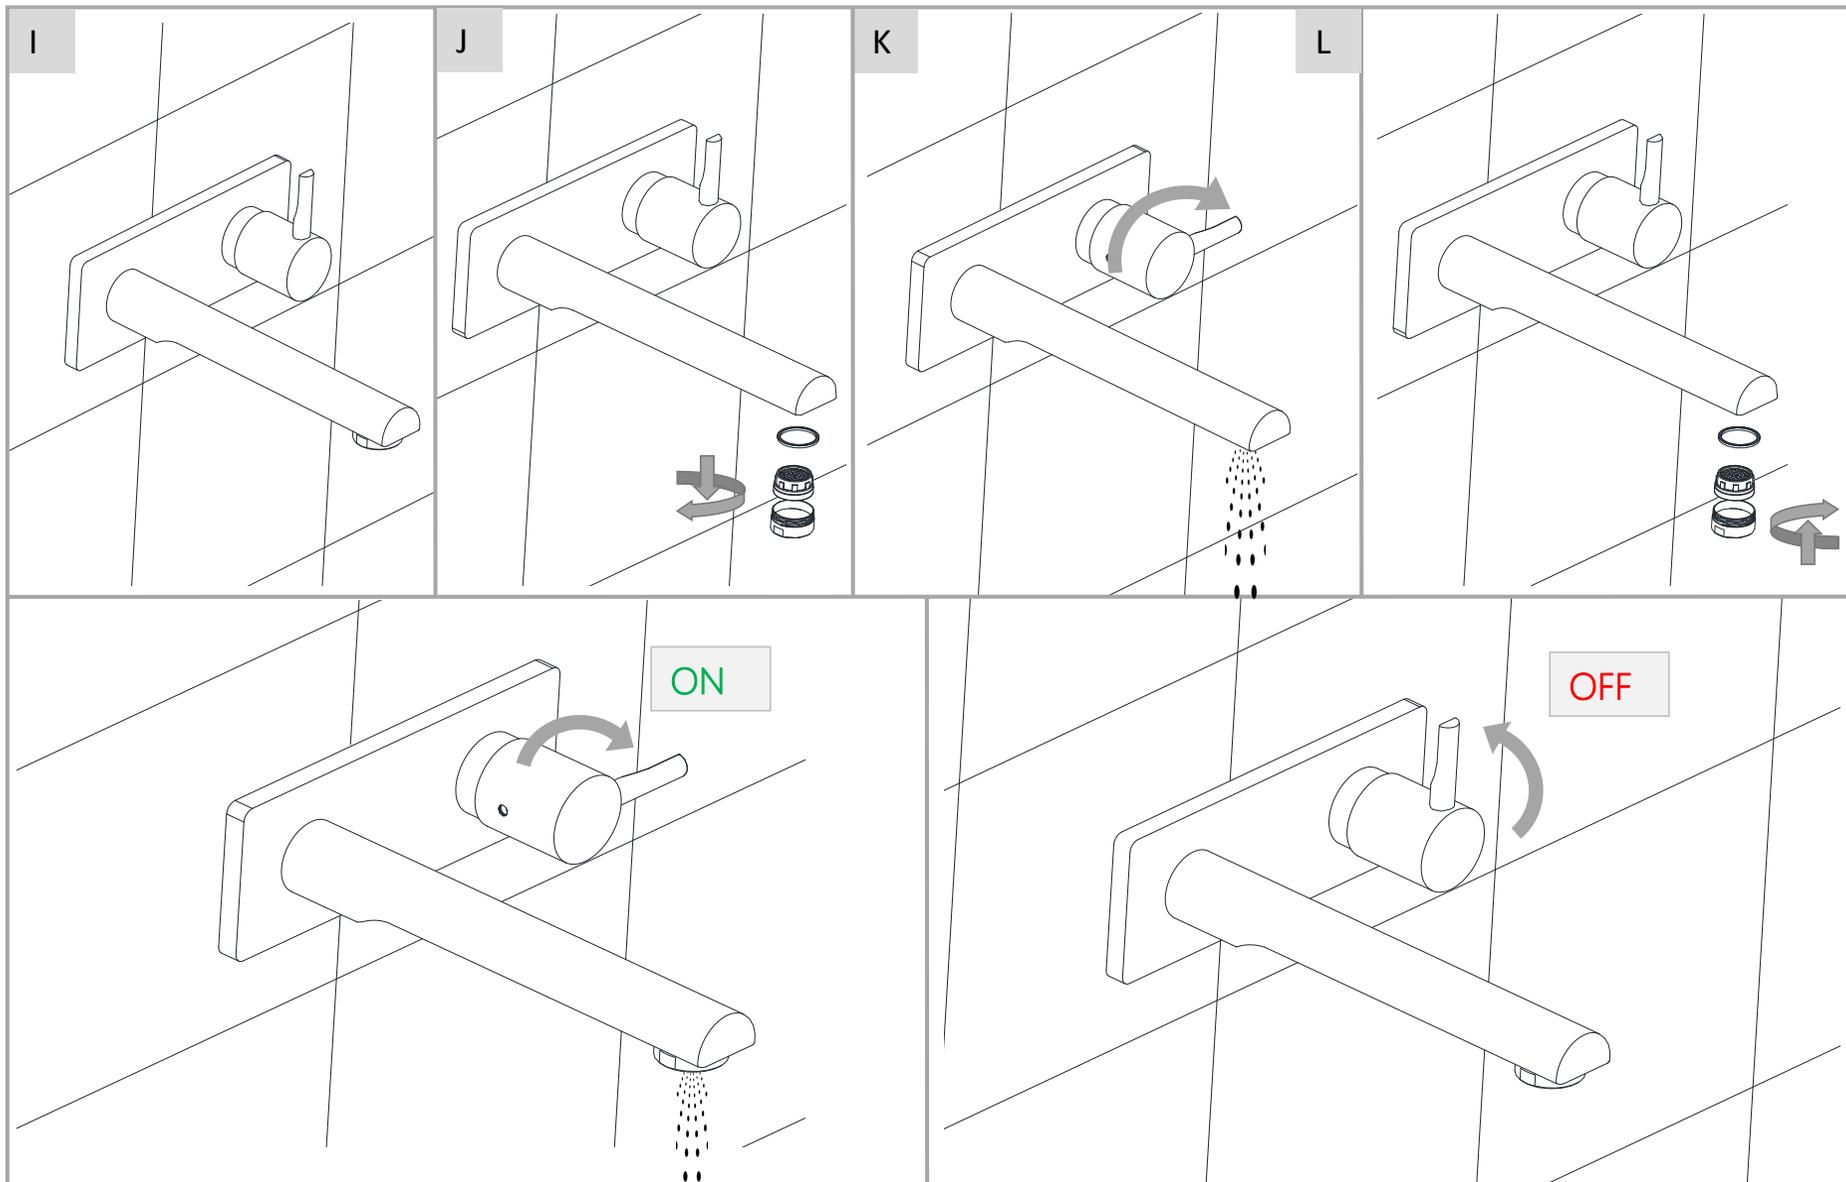

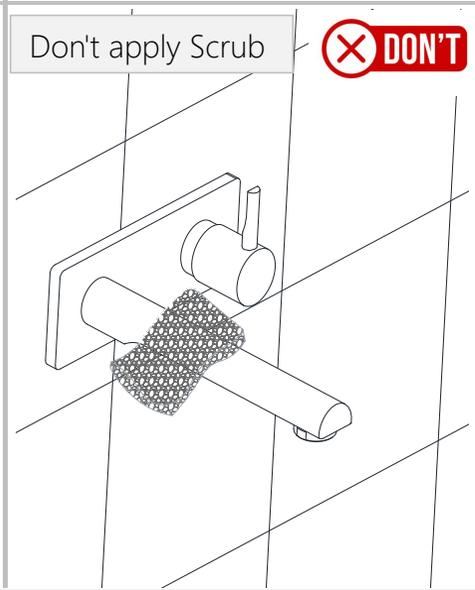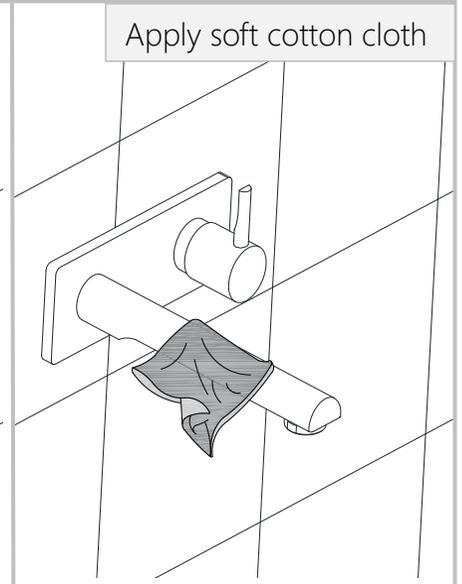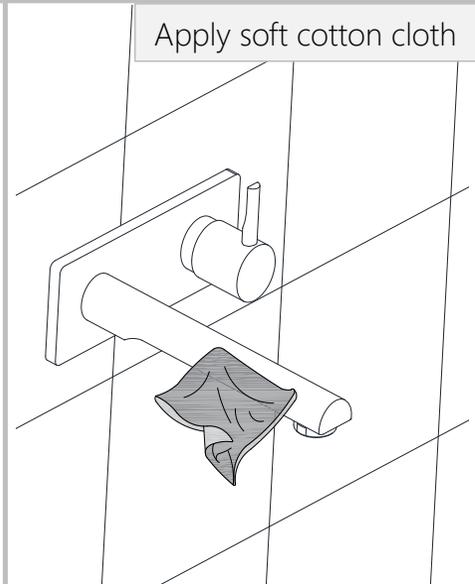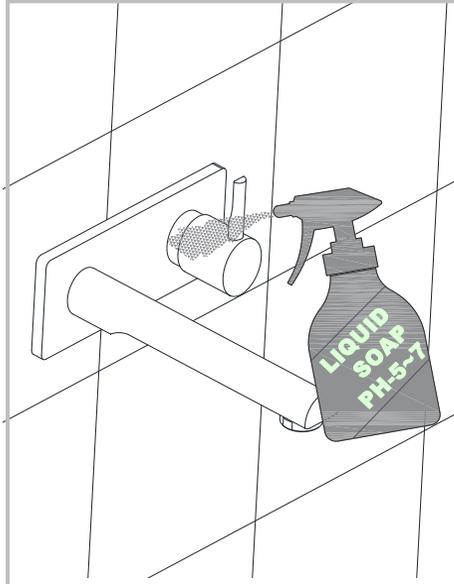

Steps & Cleaning agents requirements for Aerator Cleaning.

